



### Scheduling Meeting of 15 July 2008

**Days worked since last Recordable Injury = 79**

#### Fermilab Injuries and FY08 Goals:

	FY2005	FY2006	FY2007	FY2008 to Date	GOAL
TRC Cases	28	29	31	<b>9 (2 are subs)</b>	<b>&lt;10</b>
DART Cases	11	7	12	<b>2 (1 is sub)</b>	<b>&lt;5</b>

#### Injuries Reported from 07/07/2008 to 07/14/2008

Division	Category	Case Date	Date Entered	Reportable?	Rx	Medical		ESH		Case #
						ODD	LDD	ODD	LDD	
TD	FNAL	07/08/2008	07/08/2008	No		0	0	0	0	17386

**Medical Comments:** While using a cordless drill to build a crate, drill slipped off screw and hit employee's hand, causing an abrasion.

**ESH Comments:** Employee was attempting to start a wood screw in the horizontal position, holding the screw in his left hand. A Phillips screw driver attachment in good condition was being used, but it slipped out of the screw head, causing the screw driver attachment to come into contact with the employee's left thumb. A Band-Aid was applied at Medical. Since building wood crates is a common activity of the employee's group, the TD SSO has requested that the group purchase magnet drive guides. These are magnetized screw driver drill attachments that have a retractable sleeve that fits down over the screw, protecting the fingers and holding the screw in place. [RCR 7/9/08]



## Fermilab Leading/Lagging Indicators from 10/01/2007 to 07/14/2008

Outstanding  
  Excellent  
  Good  
  Marginal  
  Unsatisfactory

Org	ITNA Completion			Required ES&H Courses			Current ITNAs			Total Recordable Case Rate		DART Rate	
	Completed	Employees	%	Completed	Required	%	Current	Employees	%	# Cases	Rate (per 100 man-years)	# Cases	Rate (per 100 man-years)
AD	500	500	100.0%	7,928	8,135	97.5%	492	500	98.4%	0	0.00	0	0.00
APC	47	47	100.0%	413	417	99.0%	44	47	93.6%	0	0.00	0	0.00
BS	129	129	100.0%	1,580	1,643	96.2%	129	129	100.0%	0	0.00	0	0.00
CD	267	269	99.3%	2,045	2,136	95.7%	261	269	97.0%	1	0.50	0	0.00
CMS	11	11	100.0%	63	64	98.4%	11	11	100.0%	0	0.00	0	0.00
DI	45	45	100.0%	347	383	90.6%	44	45	97.8%	0	0.00	0	0.00
ES	38	38	100.0%	562	578	97.2%	38	38	100.0%	0	0.00	0	0.00
FPCA	9	9	100.0%	48	50	96.0%	9	9	100.0%	1	15.15	0	0.00
FE	120	120	100.0%	2,092	2,211	94.6%	120	120	100.0%	3	3.48	1	1.16
FI	53	53	100.0%	443	457	96.9%	53	53	100.0%	0	0.00	0	0.00
PD	456	465	98.1%	4,761	5,044	94.4%	418	465	89.9%	0	0.00	0	0.00
TD	236	236	100.0%	2,827	2,982	94.8%	232	236	98.3%	2	1.18	0	0.00
WR	90	91	98.9%	602	630	95.6%	86	91	94.5%	0	0.00	0	0.00
<b>Fermilab</b>	<b>2,001</b>	<b>2,013</b>	<b>99.4%</b>	<b>23,711</b>	<b>24,730</b>	<b>95.9%</b>	<b>1,937</b>	<b>2,013</b>	<b>96.2%</b>	<b>7</b>	<b>0.48</b>	<b>1</b>	<b>0.07</b>

ITNA Completion	90 - 100%	85 - 89.9%	80 - 84.9%	75 - 79.9%	0 - 74.9%
Required ES&H Courses	90 - 100%	85 - 89.9%	80 - 84.9%	75 - 79.9%	0 - 74.9%
Total Recordable Case Rate	0 - .65	.75 - 1.2	1.3 - 1.85	1.95 - 2.5	>2.6
DART Rate	0 - .25	.35 - .5	.6 - .75	.85 - 1	> 1.1
Current ITNAs	90 - 100%	85 - 89.9%	80 - 84.9%	75 - 79.9%	0 - 74.9%

**Annualized Injury Rate Trends:  
(INCLUDES SUBCONTRACTOR EMPLOYEES)**

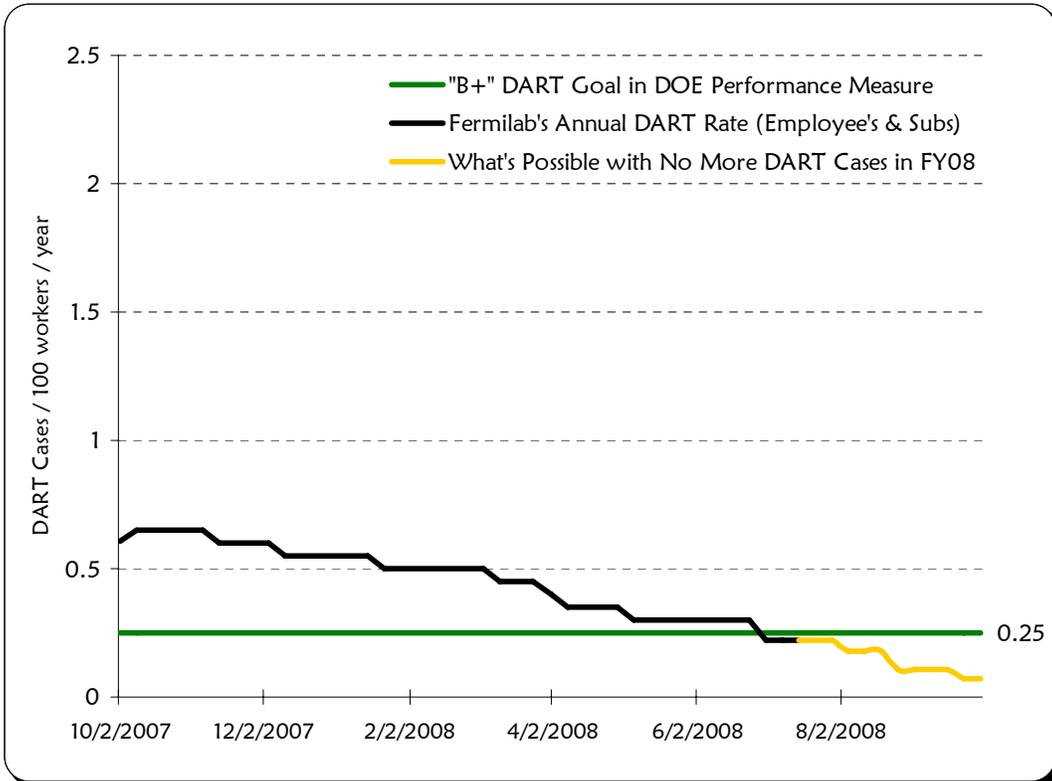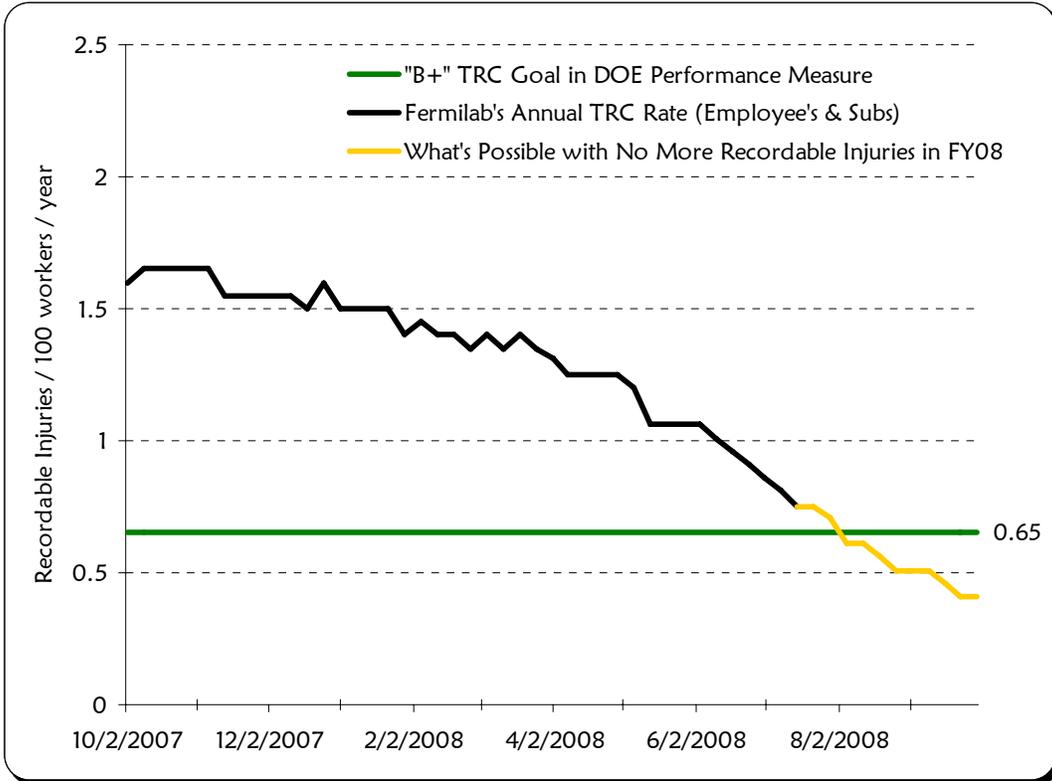

FY08 Injury Rates of DOE/SC Labs thru 3<sup>rd</sup> Quarter  
(Includes subs)

Laboratory	TRC Rate (Goal = 0.65)	DART Rate (Goal = 0.25)
Ames	0.00	0.00
JLab	0.22	0.22
<b>FNAL</b>	<b>0.61</b>	<b>0.14</b>
PNNL	0.78	0.20
PPPL	0.95	0.32
ANL	1.01	0.43
BNL	1.03	0.57
ORNL	1.08	0.24
SLAC	1.21	0.79
LBNL	1.57	0.74

So far this fiscal year, 7 reportable injuries among employee population:

- 2 cases      Shoulder injuries
- 1 case      Back injury
- 1 case      Knee injury
- 1 case      Ankle injury
- 1 case      Finger injury
- 1 case      Audiogram
  
- 2 cases      Subcontractor injuries